

Procam Controls, Inc.
2605 Technology Drive
Bldg. 300
Plano, Texas 75074
972.881.9797 ofc
972.422.6262 fax


INSTALLATION SPECIFICATIONS

TITLE

OptiPure
Filter Systems

SHEET: 1 OF 4

MODEL NO.: FX-22P
FXI-22P
FXC-22P
FXCI-22P

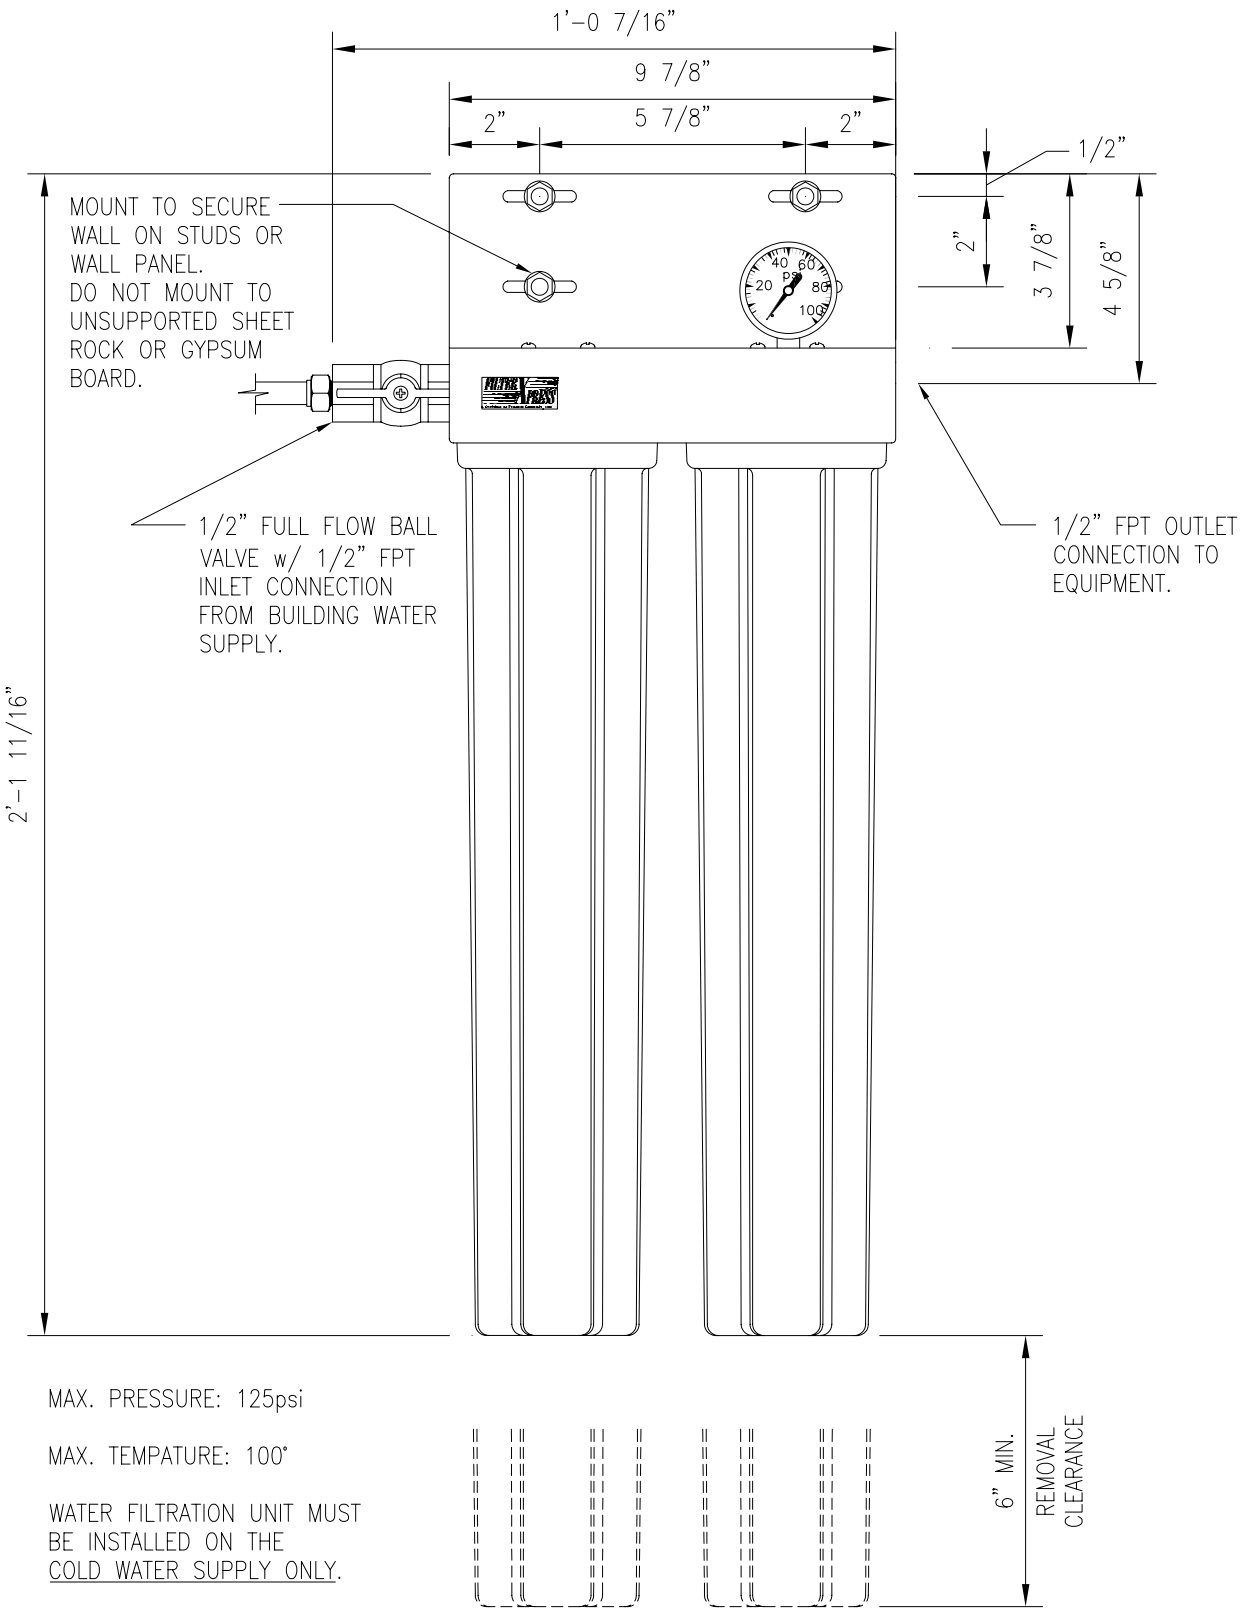

Procam Controls, Inc.
 2605 Technology Drive
 Bldg. 300
 Plano, Texas 75074
 972.881.9797 ofc
 972.422.6262 fax

INSTALLATION SPECIFICATIONS

TITLE

**OptiPure
 Filter Systems**

SHEET: 2 OF 4

MODEL NO.: FX-22P
 FXI-22P
 FXC-22P
 FXCI-22P

1/2" FULL FLOW BALL VALVE w/ 1/2" FPT INLET CONNECTION FROM BUILDING WATER SUPPLY.

2'-8" MIN. - 5'-0" A.F.F.
INSTALLATION HEIGHT

7/8"

9"

9 7/8"

MOUNT TO SECURE WALL ON STUDS OR WALL PANEL.
DO NOT MOUNT TO UNSUPPORTED SHEET ROCK OR GYPSUM BOARD.

1/2" FPT OUTLET CONNECTION TO EQUIPMENT.

WALL

NOTE:
DO NOT MOUNT FILTER ASSEMBLY BEHIND ICE MACHINE OR OTHER APPLIANCES THAT WOULD IMPEDE ACCESS FOR MAINTENANCE OF FILTRATION SYSTEM.

MAX. PRESSURE: 125psi

MAX. TEMPERATURE: 100°

WATER FILTRATION UNIT MUST BE INSTALLED ON THE COLD WATER SUPPLY ONLY.

6" MIN.
REMOVAL CLEARANCE



Procam Controls, Inc.
2605 Technology Drive
Bldg. 300
Plano, Texas 75074
972.881.9797 ofc
972.422.6262 fax


INSTALLATION SPECIFICATIONS

TITLE

OptiPure
Filter Systems

SHEET: 3 OF 4

MODEL NO.: FX-22P
FXI-22P
FXC-22P
FXCI-22P

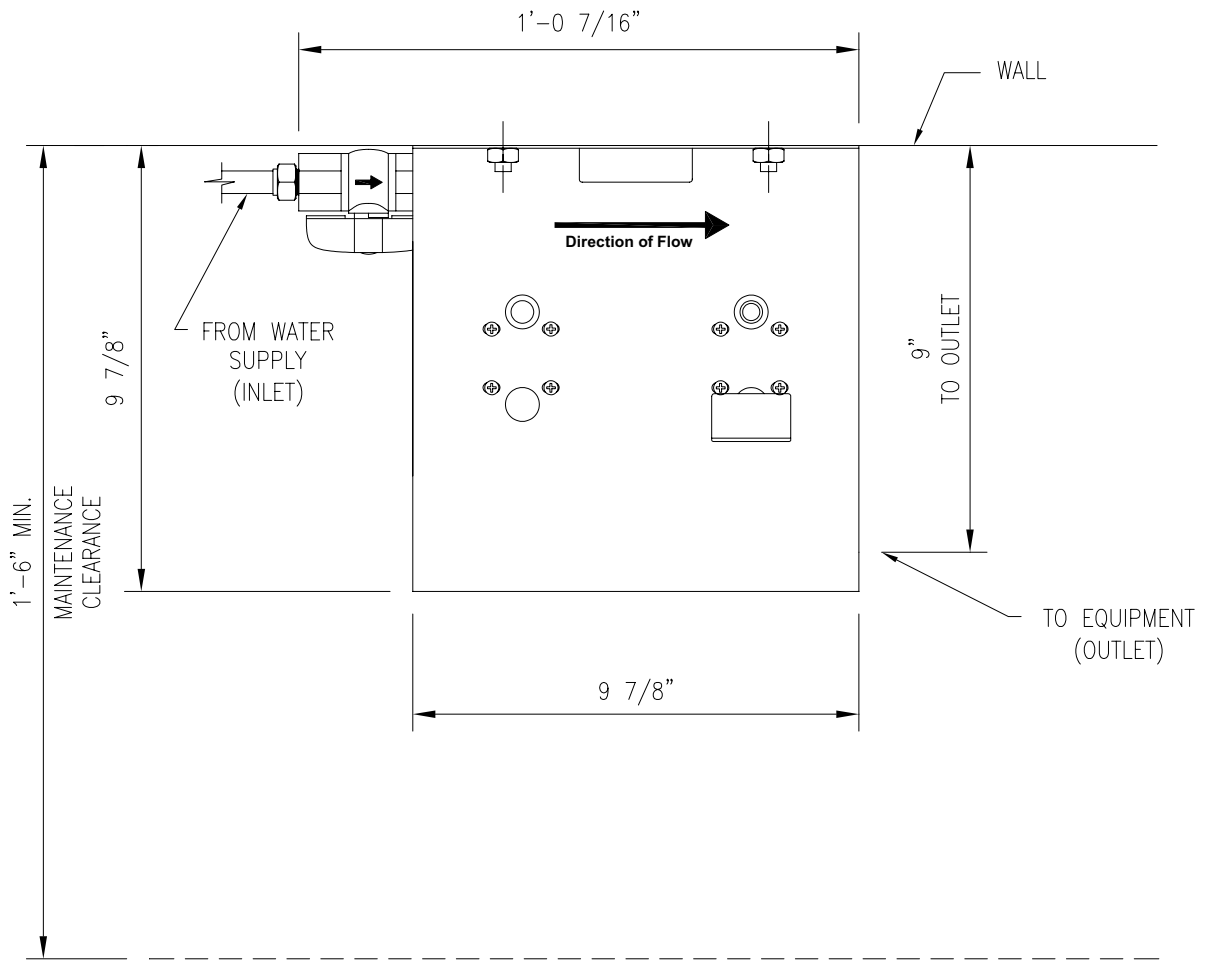

NOTE:
DO NOT MOUNT FILTER ASSEMBLY
BEHIND ICE MACHINE OR OTHER
APPLIANCES THAT WOULD IMPEDE
ACCESS FOR MAINTENANCE OF
FILTRATION SYSTEM.

MAX. PRESSURE: 125psi

MAX. TEMPERATURE: 100°

WATER FILTRATION UNIT MUST
BE INSTALLED ON THE
COLD WATER SUPPLY ONLY.



Procam Controls, Inc.
2605 Technology Drive
Bldg. 300
Plano, Texas 75074
972.881.9797 ofc
972.422.6262 fax

INSTALLATION SPECIFICATIONS

TITLE

OptiPure
Filter Systems

SHEET: 4 OF 4

MODEL NO.: FX-22P
FXI-22P
FXC-22P
FXCI-22P